22nd International Conference on Renewable Energies and Power Quality (ICREPQ'24)
Bilbao (Spain), 26th to 28th June 2024
E&Q Journal
ISSN:2659-8779. Volume 2. July 2024

New Technique to develop Intelligent High reliable & Efficient Unmanned Power Generation Modular

Jamil ABDO[1] Tariq MASOOD[2], Abdul Jabbar KHAN[3]

[1,2] Department of Engineering
101 Braddock Road, Frostburg, Maryland, 21532

[3] National Transmission & Dispatch Company, WAPDA, House Lahore
Pakistan

Abstract. *Primary aim of this research project is to develop Modular Generator Total Power Output: 1 MW or greater, integrated with High density diesel (NATO F76) generator. This modular comprises of Generators, Fuel Cells (MTBF), Gas Turbine Generators. Note that novelty will be sought on how to configure installation of multiple power units to allow for easy access for maintenance, quick removal and replacement as well as optimize operating life via controls. This proposed power modular will Operate in a marine environment condition such as salt air ingestion, ships motion in high sea states, shock, vibration. Note that novelty will be pursued on how to best optimize design to combine multiple power unit connections to a single ship interface.[1]*

Key words. *Novelty, Corrective Maintenance and Preventive maintenance and Intelligent module.*

Words	Definition
IUPG	Intelligent unmanned Power Generation
UPS	Interrupted Power System
HSE	Health, Safety & Environment
KPI	Key Performance Indicator
ARIS	Architecture integrated Information system
PM/CM	Preventive Maintenance/ Corrective Maintenance
RTOC	Real-time operating center
FSU	Frostburg State University

1. Introduction

The **Intelligent Unmanned Power Generation (IUPG)** initiative research project that aims to integrate conventional Power generation (Diesel Generator-NATO-F76) and Renewable power generation (Fuel Cell- MTBF) in real-time operations and increase value generated from our assets and extend their field life while improving their Operations Integrity, Reliability, Process safety and efficiency at optimum cost at Offshore- field Vessel facilities. This research project integrates people, process and technology and leverages data to enable faster and better decisions to achieve the following at Offshore Vessel facilitie[1,2]s.

REVENUE: Improve Asset operations Management to achieve 4000hrs no touch maintenance periodicity
MANAGEMENT: Increase assets operational health visibility via KPI Dashboards[2]

1. **REVENUE:** Improve Asset operations Management to achieve 4000hrs no touch maintenance periodicity
2. **MANAGEMENT:** Increase assets operational health visibility via KPI Dashboards
3. **HSE** Reduce risks through better understanding and mitigation of issues.[3]
4. **STAFF:** Increased productivity & Improved job satisfaction.[4]

2. Research Proposal Scope

To design and integrate conventional and unconventional Power generation systems to deliver the value inform of business model. To develop and design logical rigor control through centralized and de-centralized control system to operate unmanned the conventional and unconventional power generation models based on priority.[5] To constitute and simulate final model by using **ETAP**, **Easy-Power, Power-World**, & **PSCAD** Engineering simulation software's to deliver the results, prototype modular will be developed which cover business model, logical model, and final operational model.[6] Secondly, to achieve maintenance interval of 2000hrs to establish a comprehensive Planning & Scheduling Activities for Maintenance Work process including Minor/Unit/Emergency Shutdown works for the assets pertaining to Vessel Operations. Procedure will be developed and provided which cover defining, selecting, processing, tracking, and reporting of asset maintenance activities related to assets within Potential company. To achieve a 4,000 hour no touch maintenance periodicity for continuous operation in a naval environment. [7]

A. Technical Objectives

1) To design and establish three layers of a unified Power generation Process Plant operation: primary power plant generation renewable power generation by fuel cell, in emergency UPS (uninterrupted power system) will be integrated.[8]

2) In the initial layer of the control topology, renewable power generation operates as the primary mode, serving as the master control with the highest priority.[9]

3) In the second layer of control topology, to integrate the first backup on the control priority list, conventional Diesel power generation remained remain active for hot start-up, this will serve as spinning reserve in synchronized condition to meet the power deficiency as required without any possible interruption/transit, this will take **40 to 60 milliseconds**.[10]

4) In the third layer of control topology, to integrate the second backup on the control priority list, conventional Gas Turbine power Generation, if any case Diesel Generator failed to take the load. This will take **120 to 130 milliseconds**.[11]

5) To establish a unified Power generation Plant process that provides a basis for consistency of approach to minimize the downtime of the Plant/ Equipment/ Assets by keeping the Equipment fit-to-purpose condition by increasing the reliability, availability, and maintainability through risk-based prioritization.[12]

6) To maintain Power Generation equipment cost-effectively without compromising health, safety, environment, or power generation targets.

7) To set up defined Planning & Scheduling Activities for the Maintenance Work process by identifying the importance & criticality of Equipment in achieving the business objective concerning maintaining data, ensuring issuance and scheduling of work orders for execution, then follow-up status via reporting to assure timely completion of all the jobs through close monitoring of maintenance performance.[13]

8) Provide a fully auditable update of the maintenance history by which the decision on which and how to maintain Equipment has to be carried out by the Optimization team.[14],[15]

9) To implement a comprehensive planning and scheduling procedure for minor, unit, and emergency shutdowns in the Potential company.[16]

B. IUPG Journey

1) First stage, collect the operating data of existing plant operations (Diesel generator and renewable Energy Plant) to get immediately line of sight status and performance of the Plants, and other related operating equipment. This gives the opportunity to react for more quickly to the operations needs in the offshore-field and improve the performance and mitigate the losses faster. This keeps the offshore-field optimum operating condition all times.[17]

2) In the second stage, wide upgrade the existing equipment with data transfer facilities to available real-time in safe and secure way through data centre validated, stored and accessed with other incoming data for further processing and decision-making purposes.[18]

3) In the third stage, transformation vast amount of data in comprehensive bits and pieces information that will provide a roadmap to make final decision.

4) In the fourth stage, building dashboard to display them, dashboards are physical representation of real time processes and support uses and executing these processes. They are constructed to reflect conduct of the problems are being addressed e.g power generation dashboard, Asset integrity dashboard, PM/CM maintenance strategy dashboard. Now we need to engage jointly build right dashboard to deal with information become ready for real-time and collaborative working.[19]

5) In the fifth stage, to review adaptive workflow and processes in such a way that we can collaborate in real-time. While reacted we also review own value and behavior; we may need to adjust them accordingly and place to execute.[20]

6) In the sixth stage, the potential company will also build network for collaborative working environment, we can display these on the dashboard and exercise new workflow, these circle real-time operating centre or RTOC.

7) These centres are high-tech environment data centre, previously prepared and validated come together to display the Dashboard, we design together. We jointly analyse, discuss and make quality decision on supportive needed. We are able to anticipate the problem before they occurred [21].

3. Methodology

A. ARIS- Process Business, Logical and Executable Models

In the first instance, ARIS models developed to determine proposed topology capability and capacity with precision as shown in Figure No.1. ARIS (Architecture of Integrated Information Systems) is an approach to enterprise modelling; it offers methods for analysing process and taking a holistic view of process design-management workflow and application processing.[22]

B. ARIS – Process Model

This process demonstrates that the seamless enterprise architecture is a framework as shown in Figure No.2. This has been designed to collect and process operational data to make decisions without human intervention at offshore vessel. ARIS- Process is an integrated transformation suite established to achieve sustainable and compliant operational excellence.[23]

C. ARIS – One Methodology for Multiple Purpose

ARIS – process all aspects of the data transformation journey to automate Electrical Power generation equipment on an imperative basis from strategy to execution, process design to process mining, and risk & compliance. It grows based on customer demand to establish Intelligent unmanned Electrical power

generation modular to deliver objective-oriented goal with precision.[24]

D. *Fragmentation/ Integration Process*

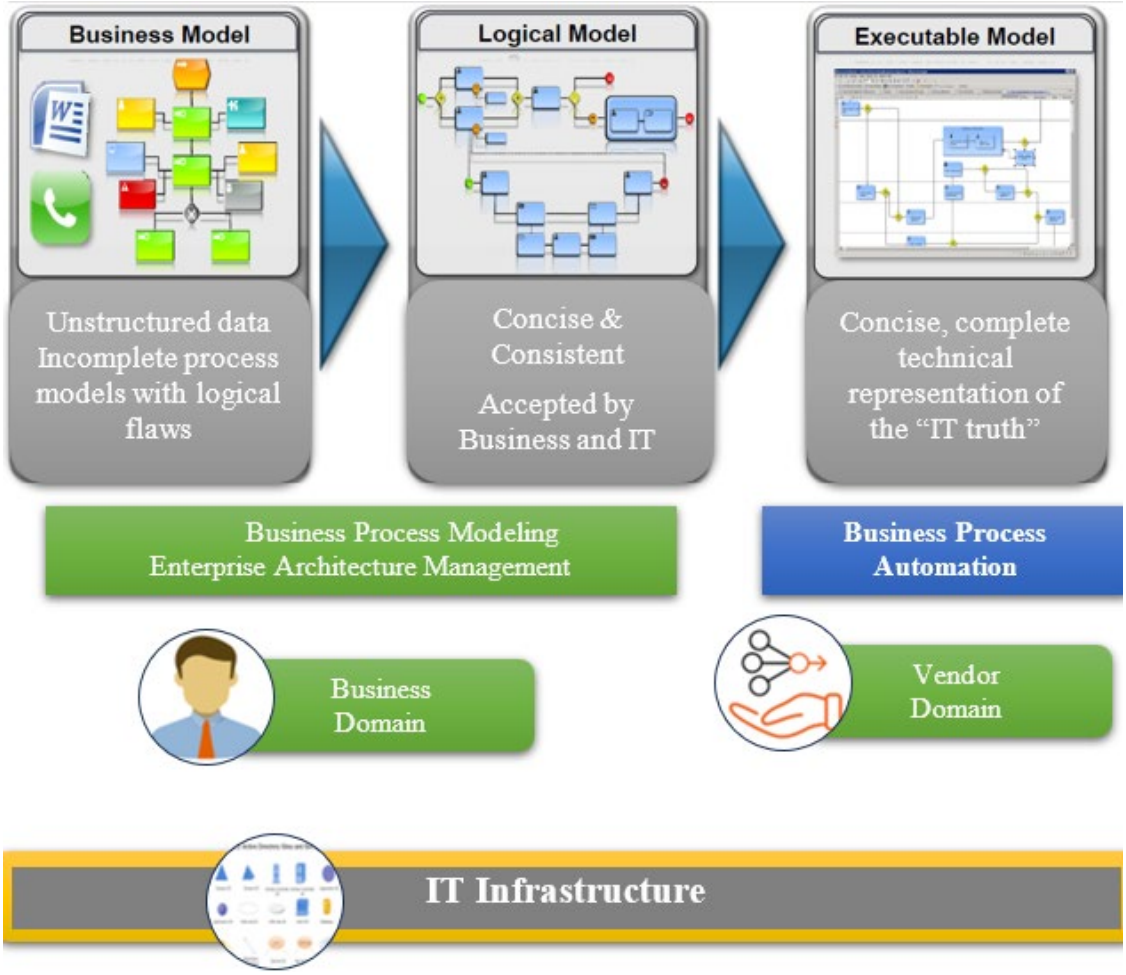

Fig. 1:ARIS – Process Business, logical and executable models' communication framework for unmanned power generation

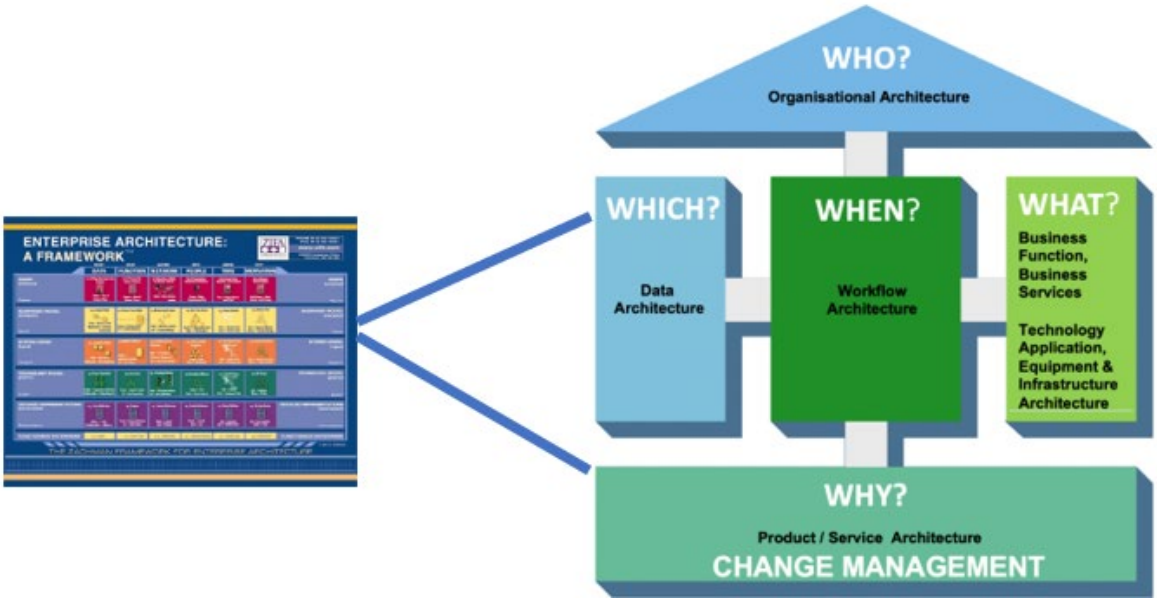

Fig. 2: ARIS – Process Customer needs and Enterprise architecture steady state model for unmanned power generation

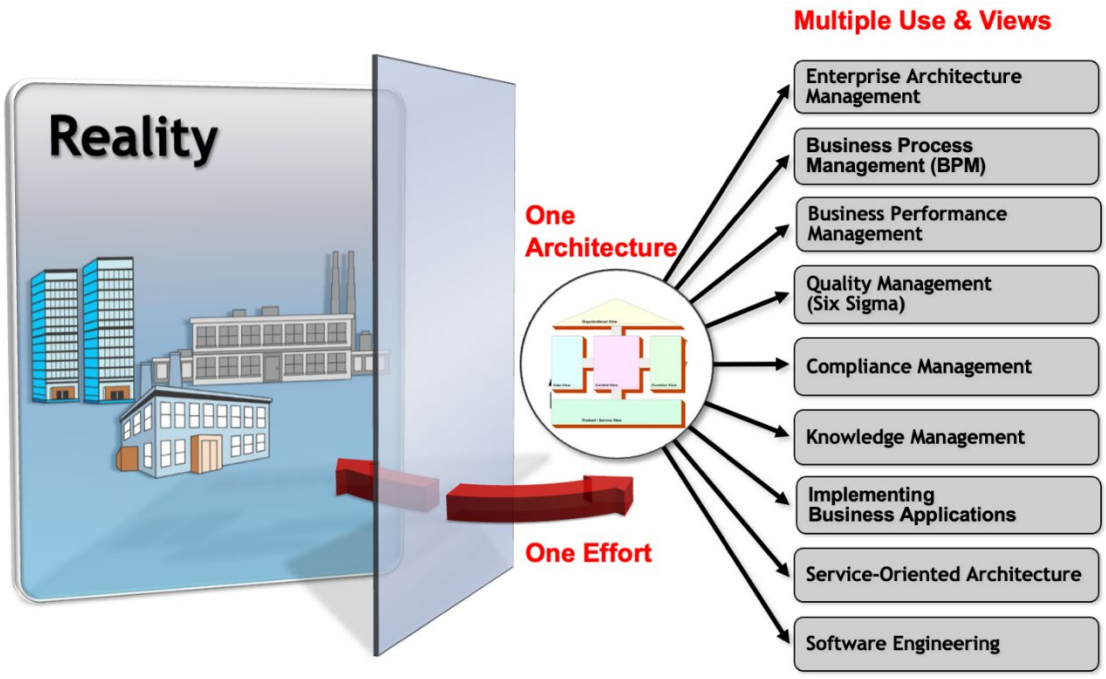

Fig. 3: ARIS – Process Integrated process methodology for multipurpose for unmanned power generation

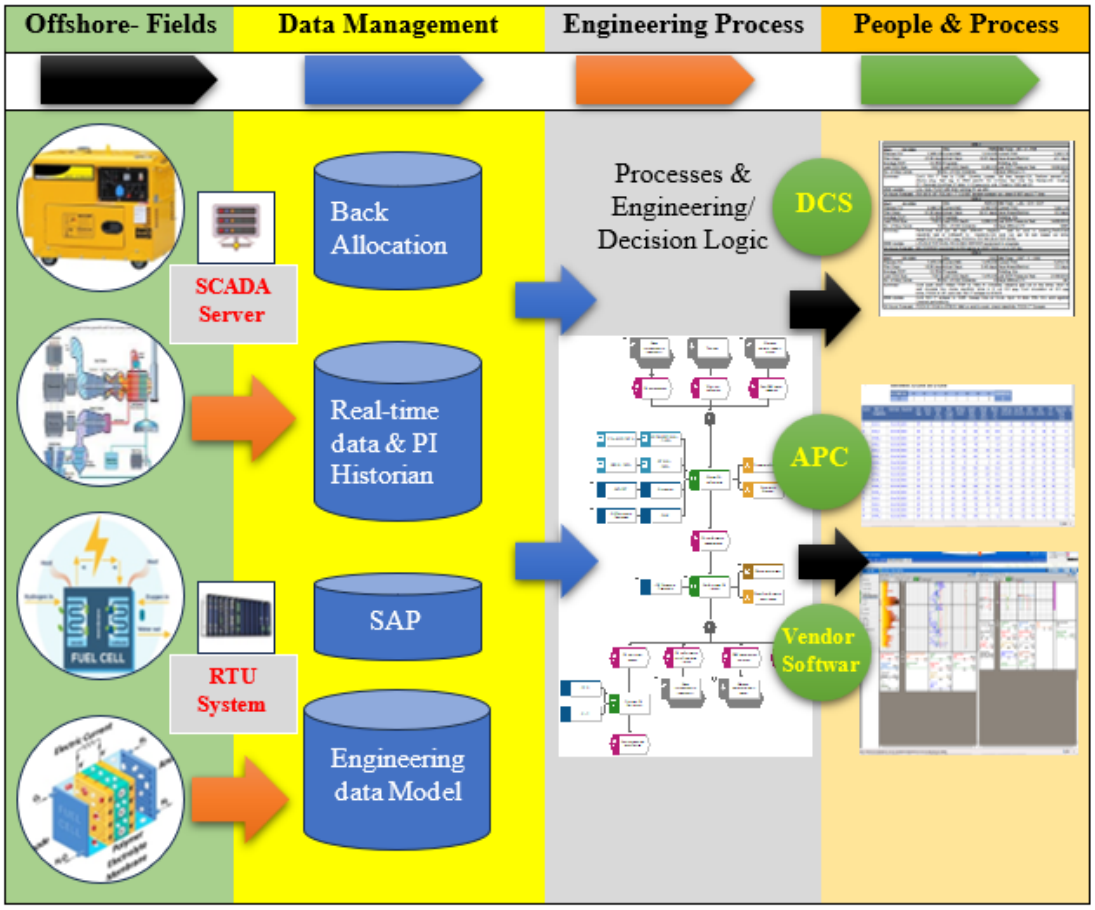

Figure 4: ARIS – Process Fragmentation and process integration for unmanned power generation

4. Centralize and De-centralize Control Topology, IUPG power delivery

Integrated power generation and delivery is being pushed closer to its thermal and stability limits. The quality of power delivered has to be maintained, which is also of great concern. Power delivery limitations have many aspects and involve power transfer between the areas on the Vassal. The power generation and delivery bottleneck and constraints may include the following characteristics of the Vassal [25], [26].

- *Steady-State Power Transfer Limit*
- *Dynamic Voltage Limit*
- *Transient Stability Limit*
- *Power System Oscillation Damping Limit*
- *Inadvertent Loop Flow Limit*

Various studies indicate that each transmission system bottleneck and regional constraint may have one or more characteristics. The integrated layered architecture has multi-proportional dependencies on each layer on a need-analysis basis. These architecture layers are described as follows.[27]

Primary layer: describes the existing control and operations philosophy of vassal power delivery. **Secondary layer**: describes the **DCS, APC, and SCADA control** and operations philosophy and their viabilities and vulnerabilities. **Tertiary layer:** the Vassal Power operational requirements or constraints and how this Power generation equipment communicate with each other to resolve any stalemate [28], [29].

Quaternary layer: describes the interface with conventional and renewable power generation systems and how these power generation facilities communicate to deliver voltage and the required power exchange at different operating conditions more pragmatically. **The Quinary layer** describes the control topology of all devices; strategically, this layer is configured with internal (de-centralized) and external (centralized) topologies. Herein, the term layer describes the meaning of one complete package or unit used to develop an individual model and its integration with other models in operation conditions at the vessel power grid. These layers also indicate four-way dependency power generation modular [30], [31].

5. Integrated Modular Power Calculation

Integrated Hybrid Control Modular have the subsequent characteristic technical values: Voltage control operates at a voltage 3.3 kV with frequency 60 Hz and contains line inductance of 0.75 mH per km; and capacitance (C)of 5.7×10^{-9}(F/Distance). The voltage on the Modular power grid needed to be regulated at 0.95 pu. Therefore, total impedance of the network is computed by using equation (1), (2), (3) and (4), as stated below: [32], [33]

$$\boldsymbol{Z_a} = \sqrt{\frac{\boldsymbol{l(nH)}}{\boldsymbol{c}}} \text{----------(1)}$$

$$\boldsymbol{Beta(\beta)} = \boldsymbol{\omega\sqrt{l \times c}} \text{----------(2)}$$

$$\boldsymbol{\theta = \beta \times d} \text{----------(3)}$$

$$\boldsymbol{P_{mx}} = \frac{\boldsymbol{V^2}}{\boldsymbol{Z_a \times Sin\theta}} \text{----------(4)}$$

A. Capacitance Control

In this model, a capacitor employed to support the voltage has been calculated by using Equation (7). Equations (8) and (9) are referred to compute P and Pn (surge impedance) Pmax is calculated as given below[34],[35].

$$\boldsymbol{V_m} = \frac{\boldsymbol{V \times cos\frac{\theta}{2}}}{\boldsymbol{cos\frac{\delta}{1}(1-K_{Cap})}} \text{---------- (5)}$$

$$\boldsymbol{P_n} = \frac{\boldsymbol{V^2}}{\boldsymbol{Z_a}} \text{----------(6)}$$

$$\boldsymbol{P} = \frac{\boldsymbol{VV_m sin\frac{\delta}{2}}}{\boldsymbol{Z_a sin\frac{\theta}{2}}} \text{----------(7)}$$

8) Results

Run the simulation and observe waveforms on THE Modular scope block. The Modular is in voltage control mode and its reference voltage is set to Vref=1.0 pu. The voltage droop of the regulator is 0.04 pu/1000 VDC.Therefore when the Modular operating point changes from fully capacitive (+50 Mvar) to fully inductive (-50 Mvar) the SVC voltage varies between 1-0.04=0.98 pu and 1+0.04=1.04 pu as shown in Figure No.5.

voltage source is set at 1.1 pu, resulting in a 1.0 pu voltage at SVC terminals. As the reference voltage Vref is set to 1.0 pu, the SVC is initially floating (zero current). The DC voltage is 1000 kV. At t=0.1s, voltage is suddenly decreased by 5.5 % (0.955 pu of nominal voltage). when the DC voltage is increased or decreased in order to vary reactive power. The steady state value of alpha (0.5 degrees) is the phase shift required to maintain a small active power flow compensating transformer and converter losses.[35]

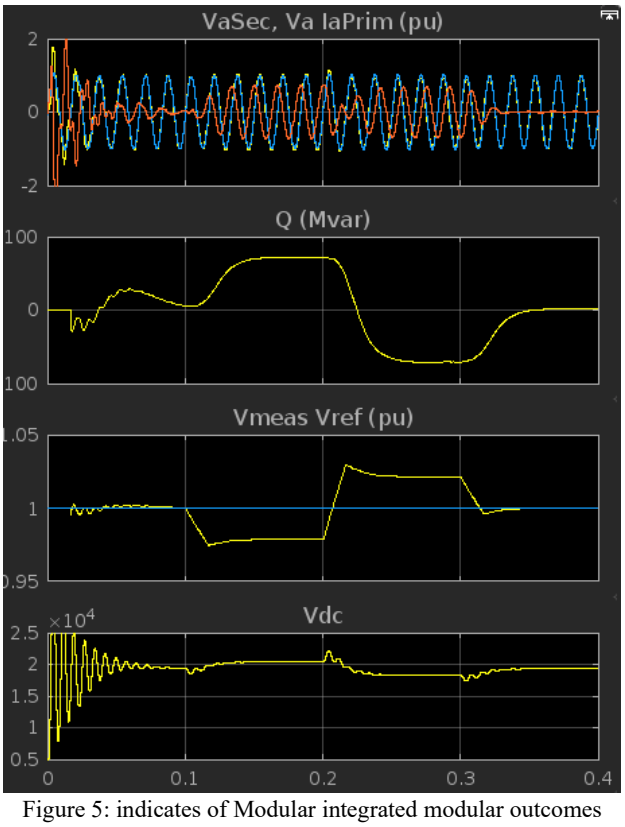

Figure 5: indicates of Modular integrated modular outcomes

9) Conclusion

The simulation results indicates that unmanned power modular will Operate in a marine environment condition such as salt air ingestion, ships motion in high sea states, shock, vibration. Note that the focus will be on achieving novelty by configuring the control loop to seamlessly integrate with both conventional and renewable power generation, ensuring a smooth transition and delivering high-quality power. Unmanned Modular single point connections for power generation couple with, fuel, cooling, exhaust, and controls. The efforts are directed towards innovatively optimizing the design to integrate multiple power unit connections into a single ship interface.

Acknowledgement

References

[1]. Basu, A. and J. M. Wainwright (2001), "DME as a Power Generation Fuel: Performance in Gas Turbines", New Delhi, India, January, presented at the PETROTECH-2001 Conf.

[2]. Bazzanella, A. M. and F. Ausfelder (2017), "Low carbon energy and feedstock for the European chemical industry – Technology study", DECHEMA, Frankfurt am Main.

[3]. Bellotti, D. et al. (2019), "Economic feasibility of methanol synthesis as a method for CO2 reduction and energy storage", Energy Procedia, Vol. 158, pp. 4721-4728.

[4]. Andersson, K. and C. Márquez Salazar (2015), Methanol as a Marine Fuel Report, report prepared for the Methanol Institute by FCBI energy

[5]. Arcoumanis, C. et al. (2008), "The potential of Di-Methyl Ether (DME) as an alternative fuel for compression ignition engines: A review", Fuel, Vol. 87, p. 1014

[6]. Atsonios, K. et al. (2016), "Investigation of technical and economic aspects for methanol production through CO2 hydrogenation", International Journal of Hydrogen Energy, Vol. 41, pp. 2202-2214

[7]. Andersson, K. and C. Márquez Salazar (2015), Methanol as a Marine Fuel Report, report prepared for the Methanol Institute by FCBI energy. BASF (2018), *https://www.basf.com/global/en/media/ news-releases/2018/11/p-18-370.html* (accessed July 2020).

[8]. Bellotti, D. et al. (2017), "Feasibility study of methanol production plant from hydrogen and captured carbon dioxide", Journal of CO2 Utilization, Vol. 21, pp. 132-138.

[9]. Swiss Liquid Future (2020a), "Fuel from water power, water and CO2", Swiss Liquid Future AG, *http://www. swiss-liquid future.ch/* (accessed June 2020).

[10]. Tariq Masood and Jamil Abdo *"Review: Uninterrupted Liquid Hydrogen (E-Methanol) Production framework to deliver Clean & Green Energy"* Published 22nd International Conference on Renewable Energies and Power Quality (ICREPQ'24) Bilbao (Spain), 26th to 28th June 2024

[11]. Jamil Abdo & Tariq Masood "*Techno Economics Analysis to Reshape Global Clean and Green Energy"* 22nd International Conference on Renewable Energies and Power Quality (ICREPQ'24) Bilbao (Spain), 26th to 28th June 2024

[12]. Tariq Masood & Jamil Abdo "*New Technique to Enhance Hybrid Renewable Energy Resources'* Operational Flexibility and Reliability" 22nd International Conference on Renewable Energies and Power Quality (ICREPQ'24) Bilbao (Spain), 26th to 28th June 2024

[13]. Jamil Abdo & Tariq Masood "*Operational Reliability-Production Best Practice Pragmatic Case Studies & Improvement*" published in Proceedings of the 9th North American Conference on Industrial Engineering and Operations Management Washington D.C., USA, June 4-6, 2024.

[14]. Tariq Masood & Jamil Abdo "*Maintenance strategy production best practices – pragmatic case studies and operations improvement*" published in Proceedings of the 9th North American Conference on Industrial Engineering and Operations Management Washington D.C., USA, June 4-6, 2024

[15]. Tariq Masood R. K. Aggarwal and Nasser Al-Emadi "Enhanced Power Flow/Voltage Control in the GCC Grid by SSSC Robustness" published ISBN: 978-3-659-40995-0. https://www.morebooks.de/shop-ui/shop/search?q=978-3-659-40995-0&page

[16]. Tariq Masood, DP Kothari "Centralized and Decentralized FACTS Controllers in Electric Power Grid" Subtitle: Innovative Robust Control Applied to Selected Power System published by New Age International. ISBN : 978-93-87788-31-2 http://www.newagepublishers.com/servlet/nagetbiblio?bno=002900

[17]. Tariq Masood, Muhammad Tajammal, Samer Kareem, Suhail Aftab Qureshi, Abdul Jabbar Khan, DP Kothari, Nair Jameel" Unified power Flow Controller Modeling and Analysis Technique on the GCC Power Grid Operations and Control" published IEEE Energy Con, 2018 June 7-9 Limassol Cyprus. https://ieeexplore.ieee.org/document/8398834/

[18]. Tariq Masood, Muhammad Tajammal, Samer Kareem, Suhail Aftab Qureshi, Murtaza Hashmi, Nasir Jameel "Unified power Flow Controller (UPFC) Modeling and Analysis Technique by using Matlab and EMTP" published (ICREQP,18 Salamanca Spain 21-23 March,2018). http://www.icrepq.com/icrepq18/250-18-masood.pdf

[19]. Tariq Masood, Muhammad Tajammal, Samer Kareem, Suhail Aftab Qureshi, Murtaza Hashmi Naser Jameel "STATCOM Controller Performance Enhancement and Optimization Technique" published (ICREQP,18 Salamanca Spain 21-23 March,18). http://www.icrepq.com/icrepq18/249-18-masood.pdf

[20]. Dr. Tariq Masood, Dr. Abdel Aty Edris, Dr. Muhammad Tajammal, Dr. Murtaza Hashmi, Dr. Nasser Al-Emadi, Dr. R.K.Aggarwal, Dr. Suhail Aftab Qureshi, Dr. D.P.Kothari "Centralized/Decentralized FACTS Controllers in Electric Grids" published by New Age International India, UK. https://www.amazon.in/Centralized-Decentralised-Facts-Controllers-Electric/dp/9387788318

[21]. Tariq Masood, Muhammad Tajammal, Samer Kareem, Suhail Aftab Qureshi, Murtaza Hashmi DP Kothari, "Smart Grid Operational functions and Control Challenges by Implementing SSSC Tailored to Optimize performance in between Qatar and KSA on the GCC Electrical-power grid" published in the ASTESJ Journal Advances in Science, Technology and Engineering Systems Journal Vol. 2, No. 1, 30.09.2017. https://pdfs.semanticscholar.org/dfba/184b2f7697d4e1f56d3eae96e4a400d02cd7.pdf

[22]. Tariq Masood, Abdel Aty Edris, Suhail Aftab Qureshi, Muhammad Tajammal, Murtaza Hashmi DP Kothari, Samer Kareem "Smart Grid Operations and Control Challenge by Implementing STATCOM Tailored to Optimization Performance at the GCC Power Grid" published in the 13th IET International conference on AC and DC power Transmission Conference on 14-16 February, 2017. http://ieeexplore.ieee.org/document/7934988/

[23]. Tariq Masood, Abdel Aty Edris, Suahil Aftab Qureshi, Muhammad Tajammal, Murtaza Hashmi DP Kothari, Samer Kareem "SSSC tailored to optimization performance in Between United Arab Emirates and Oman on the GCC

Power Grid" published in the 13th IET International conference on AC and DC power Transmission Conference on 14-16 February, 2017. http://ieeexplore.ieee.org/document/7934934/

[24]. Tariq Masood, R.K. Aggarwal, Nasser Al-Emadi , Suhail Aftab Qureshi, D.P. Kothari "Novel Control of a UPFC Connecting the Kingdom of Saudi Arabia and Kuwait in the GCC Interconnection", publication by International Journal of Automation and Power Engineering Volume 3 Issue 1, May 2014. https://www.academia.edu/34708818

[25]. Tariq Masood, R.K. Aggarwal Nasser Alemadi and D.P. Kothari "Novel Selection Approach of STATCOM Device Tailored and Optimized Engineering Configuration to Implement in Between Qatar and Bahrain': published by International Journal of Automation and Power Engineering Volume 3 Issue 1, March 2014. https://www.academia.edu/34708817

[26]. Tariq Masood, R.K. Aggarwal Nasser Alemadi and D.P. Kothari "Novel Control of a SSSC Connecting the United Arab Emirates and Oman on the GCC Power Grid Interconnection": published by International Journal of Automation and Power Engineering Volume 2 Issue 1, January 2013. https://www.academia.edu/27492136

[27]. Tariq Masood, Abdel Aty-Edris, Rashid A. Alammari R.K. Aggarwal, "Multiple FACTS devices integration through distributed control system and its application on the GCC interconnection" published in 7th IEEE GCC International conference for presentation on 18 November, 2013. http://ieeexplore.ieee.org/document/6705750/

[28]. Tariq Masood, R.K. Aggarwal, Nasser Al-Eamdi "Enhanced Power Flow/Voltage Control in the GCC Grid by SSSC Robustness" published by Lambert in 2013 ISBN: 978-3-659-40995-0.https://www.amazon.com/Enhanced-Power-Voltage-Control-Robustness/dp/3659409952

[29]. Tariq Masood, R.K. Aggarwal, S.A. Qureshi "Novel Control of a SSSC Connecting the Oman and United Arab Emirates in the GCC power Grid Interconnection" published in IJAPE International Journal of Automation and Power Engineering, Volume 2, issue 1 January, 2013. https://dn790008.ca.archive.org/0/items/IJAPE095/IJAPE095.pdf

[30]. Tariq Masood, R.K. Aggarwal, S.A. Qureshi, R.A.J Khan STATCOM and SVC Control Operations and Optimization during Network Fault Conditions: IEEE International Symposium on Industrial Electronics ISIE-2010 Bari Italy (04-07 July, 2010) http://ieeexplore.ieee.org/document/5636868/

[31]. Tariq Masood, R.K. Aggarwal, S.A. Qureshi , R.A.J Khan "STATCOM Model against SVC Control Model Performance Analyses Technique by Matlab": (ICREQP,10 Granada Spain 23-25 March,10). http://icrepq.com/icrepq'10/655-Masood.pdf

[32]. Tariq Masood, R.K. Aggarwal, S.A. Qureshi , R.A.J Khan "STATCOM Model against SVC Control Model Performance Analyses Technique by Matlab": published in RE & PQJ (Renewable Energy and Power Quality Journal), Vol.1, No.8, April 2010: https://doi.org/10.24084/repqj08.655 (ISBN: 978-84-613-7543-1)

[33]. Tariq Masood, R.K. Aggarwal, S.A. Qureshi , R.A.J Khan "STATCOM Control Reconfiguration Technique for Steady State and Dynamic Performance Optimization during Network Fault Conditions": (ICREQP,10 Granada Spain 23-25 March,10) http://www.icrepq.com/icrepq'10/656-Masood.pdf

[34]. Tariq Masood, R.K. Aggarwal, S.A. Qureshi , R.A.J Khan "STATCOM Control Reconfiguration Technique for Steady State and Dynamic Performance Optimization during Network Fault Conditions": publish in RE & PQJ (Renewable and Power Quality Journal), Vol.1, No.8, April 2010: https://doi.org/10.24084/repqj08.656 (ISBN: 978-84-613-7543-1)

[35]. Tariq Masood, Dr. S. A Qureshi, Dr. A.j Khan, Dr.Nasser Elamedi, Yacob Y.Almulla, S K Shah "FACTS Control Devices (STATCOM, SSSC and UPFC) Re-Configuration Techniques By Psim/Matlab" Papers published ICEE2007 on 11-12th April, 2007 at UET/RCET Lahore _ Pakistan. http://ieeexplore.ieee.org/document/4287295/