22nd International Conference on Renewable Energies and Power Quality (ICREPQ'24)
Bilbao (Spain), 26th to 28th June 2024
E&Q, Journal
ISSN:2659-8779. Volume 2. July 2024

New Technique to enhance Hybrid Renewable Energy Resources Operational Flexibility and Reliability

Tariq MASOOD[2], Jamil ABDO[1], Abdul Jabbar KHAN[3]

[1,2] Department of Engineering
101 Braddock Road, Frostburg, Maryland, 21532

[3] National Transmission & Dispatch Company, WAPDA, House Lahore Pakistan

Abstract. *In this research four integrated strategies proposed and discussed for increasing the flexibility of hydropower operations. This initiative seeks to understand, enable, and improve the contribution of hydropower, including pumped storage hydropower (PSH) to reliability, resilience, and integration in the rapidly evolving U.S. electricity system. Hydropower's flexibility is central to enhancing all these contributions. Four KFA (key focus areas) listed below to maintain and reliable operations. These KFAs will develop a suite of advancements that improve hydropower flexibility at multiple scales: improved components within the plant, improved hybridized capabilities at the plant interconnection, and improved operations across the fleet.[1],[2],[3]*

1. *HSE in Hydropower Hybrids*
2. *Reliable productivity*
3. *Technologies to Increase Flexibility*
4. *Operational Flexibility*

Key words. *Novelty, Corrective Maintenance and Preventive maintenance and Intelligent module.*

Words	Definition
DMR	Damage mechanism review in process
RBI	Risk based inspection
HSE	Health, Safety & Environment
KPI	Key Performance Indicator
FMEA	Architecture integrated Information system
PM/CM	Preventive Maintenance/ Corrective Maintenance
RTOC	Real-time operating center
FSU	Frostburg State University
MOC	Management of Change
MICE	mechanical Integrity of Critical Equipment
RCA	Root cause Analysis
FMEA	Failure mode & effects analysis
VFT	variable-frequency transformers

1. Introduction

The electric power system is vast and complex, integrating conventional and unconventional distributed power generation resources. These power resources are characterized by sharing varying renewable sources, which consist of *Geothermal, Fuel Cells, Green Hydrogen, Nuclear Energy, Wind Power, Biofuels and Biomass, Hydroelectric Power, Solar Thermal Energy Systems, Photovoltaic Systems, Greenhouse Gas Accounting.* At the same time, sharing electricity is accomplished through increased renewable sources. Industrial advances and environmental concerns make the interconnection of renewable energy sources a tendency toward the distribution generation network to enhance operational flexibility: [4],[5],[6]

(a) Hydropower mode of delivery. Physics of hydrology. Power, head, flow rate. Turbine hydrodynamics
(b) reduce environmental impact, minimize investment in power plant construction, equipment, and cost,
(c) increasing energy stable efficiency
(d) ride-through capability provided by energy storage and
(e) alleviate consequences of sudden grid outages; microgrids are becoming popular.

The US power network comprises Eastern Interconnections, Western Interconnections, Texas Interconnection, Quebec Interconnection, and Alaska Interconnection.[7] These Interconnections are tied to each other via high-voltage direct current power transmission lines (DC ties) or variable-frequency transformers (VFT)[8]. The Eastern Interconnection is tied to the Western Interconnection with six DC ties, the Texas Interconnection with two DC ties, and the Quebec Interconnection with four DC ties and a VFT [9]. The VFT permits a controlled flow of energy while also functionally isolating the independent AC frequencies of each side[10],[11]. After successfully implementing Hybrid Hydro Electric power operations, the legacy power system may move to evolving power system operations and control.[12],[13],[14]

(a) Power quality and stability
(b) Frequency regulation
(c) Spinning reserve
(d) Load following and ramping
(e) Forecasting and system protection

2. Research Proposal Scope

The distribution generators vary based on load demand. Microgrid structures are designed to meet customer requirements by incorporating renewable energy resources[15],[16]. The microgrid structure consists of five major components to make power system operations more reliable and flexible [17],[18],[19].

- micro sources or distributed generators,
- flexible loads,
- distributed energy storage devices,
- Control systems and the point of standard coupling components, connected to a low-voltage distribution network, can operate in a controlled, coordinated manner in both the connected to the utility grid or landed states.

Different approaches exist to the operation of microgrids. Other types of renewable energy resources are involved as the power generators in a microgrid [20],[21],[22]. The components within microgrids form a wide variety. The elements of the microgrid are shown in Fig.1. A simplified microgrid system is equipped with (a) controllable generation like diesel generators and load banks, not controllable generators (limited) like the photovoltaic cell and wind turbine, and (c) distributed energy storage like batteries and super-capacitors as schemed in Figure 2. Storage units can balance reserves within the short-term to long-term application range [23],[24],[25]. The flexible microgrid is connected to the upstream network, which can receive the whole or partial energy from the primary grid. When connected to a grid, it can both receive or inject power into the primary grid, indicating that it can improve the grid efficiency and resolve energy crises to a certain degree. Some examples of sustainable energy systems used in the research and articles for energy management operation of microgrid. [26],[27],[28], [29]

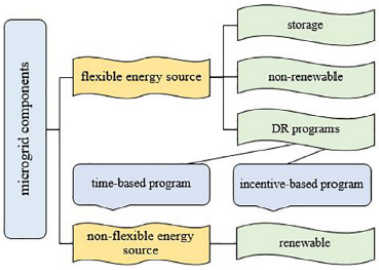

Fig.1 flexible microgrid components

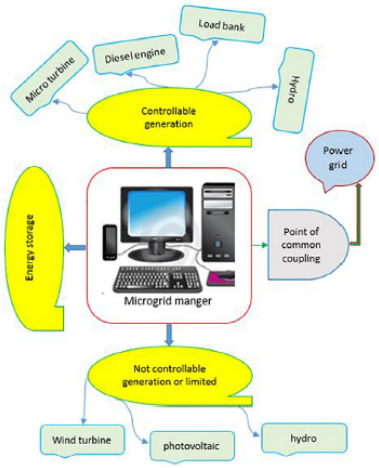

Fig.2 flexible integrated grid components

3. Hybrid operations

In conventional distributed power generation networks, e.g., thermal power generation, the generator control system frequency is controlled at a set value by adjusting power output [30],[31],[32]. However, inverter-connected Renewable Energy sources do not contribute to frequency control due to their fluctuating characteristics. The large scale of fluctuating RE power would cause fluctuation of system frequency [33],[34]. The frequency fluctuation could cause tripping renewable inverters, large-scale generation loss, instantaneous frequency drops, and more renewable inverters. Hybrid Hydropower systems provide high-level operational reliability and flexibility by integrating with other RE resources.[35],[36]

1. New Energy technologies and services
2. Increasing penetration of variable renewable on the grid
3. New communication and controls
4. Integrating distributed energy storage
5. Electrification of transportation

Valued can be derived from the renewable sources as witnessed in years 2003-2015 based on net-load how much solar system compensated as shown in Fig.3[37]. The grid services and flexibility also demonstrate solar mitigate value erosion through plant operational control as indicated in Fig.4. in the last instances Fig.5 indicates the increased operational flexibility, storage of power (Hours, not days) shifts the timing of solar and makes it dispatchable.[38],[39]

4. Power Network Performance

In this model the Smart devices are employed on the two-bus system and its computation. This describes the set of tailored equations which are an essential to develop the model and synthesize in two bus system and simulate to achieve desired results on the electrical power system[40].

$$R_1, X_1 = L_1 \omega R_s \ldots\ldots\ldots\ldots\ldots\ldots (1)$$

$$X_s = L_s \omega \ldots\ldots\ldots\ldots\ldots\ldots\ldots\ldots (2)$$

Equation (1) and (2) values are computed by considering short circuit power references. There are two critical parameters must be considered (1) XR=X/R ratio (2) power system short-circuit to witness required results. Further assessment can be performed as given below. Wherein the X=Lω and the operative parameters of the electrical power transmission-network are computed rigorously to integrate, by using the equations (3) and (4) as given below[41].

$$R = \frac{V_n^2}{S_{sc}\sqrt{1+XR^2}} \ldots\ldots\ldots\ldots\ldots\ldots (3)$$

$$L\omega = XR \ldots\ldots\ldots\ldots\ldots\ldots\ldots (4)$$

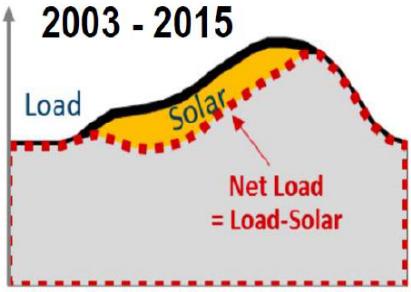

Fig.3 Value derived

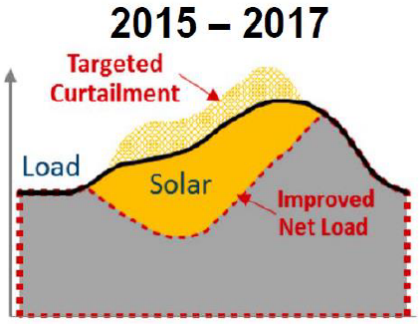

Fig.4 Grid Services

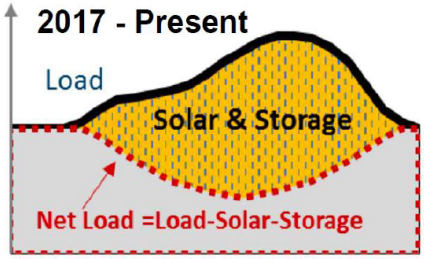

Fig.5 Increase Flexibility

5. Operational flexibility Results/Discussion

The Hybrid plant operations designed and developed numerous initiatives to implement operational flexible initiatives in the line of production best practices. Based on that, these constituted four strategy groups: ***Fig.6 shows the Operations reliability& its integral components, Fig.7 shows the Process Equipment Reliability Model, Fig.8 shows the RIM- Record Information management system, and Fig.9 shows the Electrical and Instrument control model.*** These Models are integrated to implement in line with the operational strategy to enhance equipment operational flexibility and integrity to address the challenges to maximize equipment uptime to achieve zero trip incidents. [41]

1) Inspection plan, Rules, and responsibilities to determine operational behavior of the facilities: pumped storage, spillways, crossflow, and gates
2) PMs completion >90% target
3) enhance operations and maintenance staff skills, which is cost-effective.
4) strictly following Standard Maintenance procedure (SMP) for jobs in the field
5) Inspection, Testing, and Preventive Maintenance (ITPM)
6) Equipment Deficiency Management
7) Quality Assurance / Quality Control
8) Written Procedures
9) Training
10) Continuous improvement
11) Audits & Metrics Review
12) DMR (Damage management review) and its prevention mechanism, a comparative analysis recommended, and how we are executing DMR/ prevention to be completed by the **corrosion and inspection team**).
13) MICE completion to be 100% **(mechanical Integrity of Critical Equipment). The reliability team** needs to check the status of the MICE, how we have set MICE criteria, and the completion ratio of PM and CM as planned in percentage.
14) A thickness monitoring mechanism has also been implemented at different locations of the pipeline and high pressure; based on that, we are determining potential leakage or slippage.
15) Rotating equipment to implement FMEA through Meridium management software.
16) Risk-based inspection (RBI) DMR also complement each other
17) Based on the inspection, we have to implement recommendations to improve the system; otherwise, it will stay in the gray area.
18) Develop Inspection Testing Plans
19) MI critical equipment

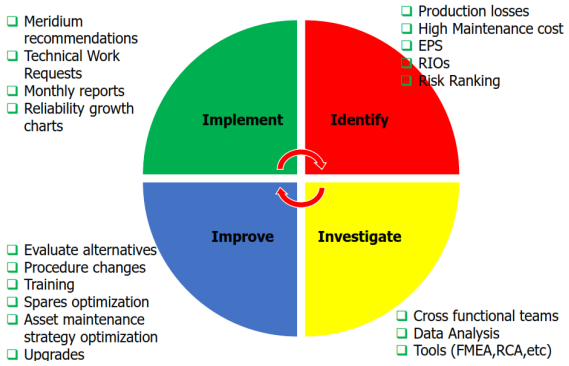

Fig.6 Operational Reliability Model

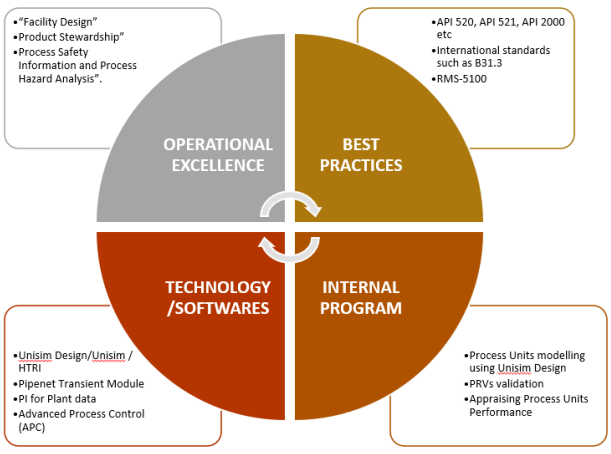

Fig.7 Process Equipment Flexibility Model

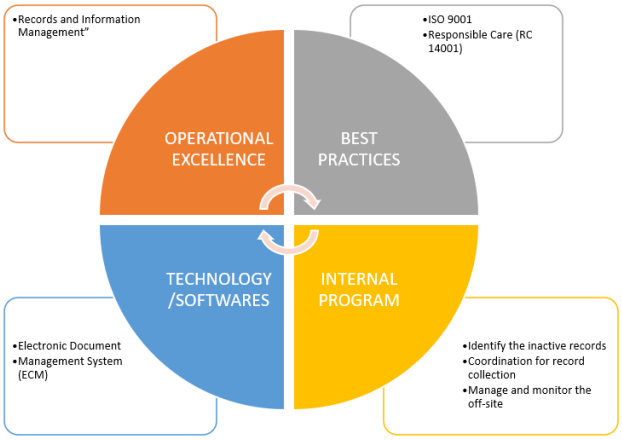

Fig.8 Process Flexibility RIM Model

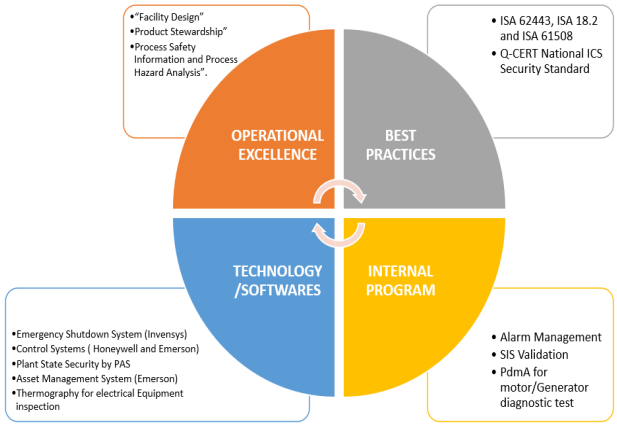

Fig.9 Operational flexibility control model

6. Conclusion

In this research, we have identified and determined to manage asset reliability risks that adversely affect plant or business operations to improve hydride operational flexibility by integrating different conventional and renewable energy resources. Effectively, the Bad Actors-Items with failures (Reactive) RIOs (reliability improvement opportunities)-Items without failures (Proactive). Cross-functional teams comprise production, maintenance, technical, and process teams.

1) Hydropower Hybrids operations
2) Technologies to Increase Flexibility
3) Operational Flexibility

Four strategies have been thoroughly discussed for increasing the flexibility of hydropower plant operations.

In this novelty, I am developing new operational strategies for Hybrid's different plants, solar, wind, and fuel cells. Essentially, it is to understand, enable, and improve the contribution of hydropower, including pumped storage hydropower (PSH), to reliability, resilience, and integration in the rapidly evolving U.S. electricity system. After successful implementation, these defined strategies witnessed Improved components within the plant, improved hybridized capabilities at the plant interconnection, and improved operations across the fleet.

These are critical aspects and considerations that we intend to explore in this research:

- **Hydro-resource power production**. Hydropower mode of delivery. Physics of hydrology. Power, head, flow rate. Turbine hydrodynamics; Francis, Kaplan, Pelton, Turgo, crossflow. System components: generators, governors, penstocks, spillways, valves, gates, and trash racks. Large-scale and micro-hydroelectric systems. Pumped storage. Economic and environmental considerations.
- **Hybrid Renewable Systems**: Investigate the benefits of creating a hybrid renewable energy system that combines solar and wind technologies. This can enhance the overall efficiency and reliability of the system, especially in locations with variable weather conditions.

Acknowledgement

I express my deep gratitude to Prof. Dr. Jamil Abdo Chairman of Department of Engineering for his unprecedented support to make everything possible at FSU.

References

[1]. **Tariq Masood** "**Total Plant Reliability**" published in 29th GCC Production and Maintenance Conference conducted on 03/10/2011 to 05/10/2011 (QP-Qatar, ADNOC-United Arab Emirates, KOC- Kuwait, ARAMCO- Saudi Arabia, BAPCO-Bahrain, PDO Oman)

[2]. **Tariq Masood** "**Inspection and Testing**" published in 23rd GCC Production and Maintenance conference conducted on 26/10/2008 to 28/10/2008 (QP-Qatar, ADNOC-United Arab Emirates, KOC- Kuwait, ARAMCO- Saudi Arabia, BAPCO-Bahrain, PDO Oman)

[3]. **Tariq Masood** "**Maintenance Planning and scheduling**" published in 33rd GCC Production and Maintenance Conference conducted on 01/10/2013 to 03/10/2013 (QP-Qatar, ADNOC-United Arab Emirates, KOC- Kuwait, ARAMCO- Saudi Arabia, BAPCO-Bahrain, PDO Oman)

[4]. **Tariq Masood "Process Safety & Permit to work Challenges"** 1st Operational Safety Challenges Symposium (Onshore, Offshore QP Operations, QatarGas, RASGAS, Q.Chem, QAFAC, Oryx, Shell Global, Total, QAPCO, ORYX-GTL, Maersk Oil, QAFCO, Qatar University, Texas A&M Qatar) conducted on 24-25 January, 2013.

[5]. **Tariq Masood** "**Production Optimization**" published in 32nd GCC Production and Maintenance Conference conducted on 03/10/2012 to 05/10/2012 (QP-Qatar, ADNOC-United Arab Emirates, KOC- Kuwait, ARAMCO-Saudi Arabia, BAPCO-Bahrain, PDO Oman)

[6]. M.Saeed Ullah, Umair Zahid, **Tariq Masood** "Optimization of Froth Flotation variables for Pyritic Sulfur Removal from Pakistan Coal (Bituminous)" Under review process

[7]. **Basu, A. and J. M. Wainwright** (2001), "DME as a Power Generation Fuel: Performance in Gas Turbines", New Delhi, India, January, presented at the PETROTECH-2001 Conf.

[8]. **Bazzanella, A. M. and F. Ausfelder** (2017), "Low carbon energy and feedstock for the European chemical industry – Technology study", DECHEMA, Frankfurt am Main.

[9]. **Bellotti, D. et al.** (2019), "Economic feasibility of methanol synthesis as a method for CO2 reduction and energy storage", Energy Procedia, Vol. 158, pp. 4721-4728.

[10]. **Andersson, K. and C. Márquez Salazar** (2015), Methanol as a Marine Fuel Report, report prepared for the Methanol Institute by FCBI energy

[11]. **Arcoumanis, C. et al.** (2008), "The potential of Di-Methyl Ether (DME) as an alternative fuel for compression ignition engines: A review", Fuel, Vol. 87, p. 1014

[12]. **Atsonios, K. et al.** (2016), "Investigation of technical and economic aspects for methanol production through CO2 hydrogenation", International Journal of Hydrogen Energy, Vol. 41, pp. 2202-2214

[13]. **Andersson, K. and C. Márquez Salazar** (2015), Methanol as a Marine Fuel Report, report prepared for the Methanol Institute by FCBI energy. **BASF** (2018), *https://www.basf.com/global/en/media/ news-releases/2018/11/p-18-370.html* (accessed July 2020).

[14]. **Bellotti, D. et al.** (2017), "Feasibility study of methanol production plant from hydrogen and captured carbon dioxide", Journal of CO2 Utilization, Vol. 21, pp. 132-138.

[15]. **Swiss Liquid Future** (2020a), "Fuel from water power, water and CO2", Swiss Liquid Future AG, *http://www. swiss-liquid future.ch/* (accessed June 2020).

[16]. Tariq Masood and Jamil Abdo *"Review: Uninterrupted Liquid Hydrogen (E-Methanol) Production framework to deliver Clean & Green Energy"* Published 22nd International Conference on Renewable Energies and Power Quality (ICREPQ'24) Bilbao (Spain), 26th to 28th June 2024

[17]. Jamil Abdo & Tariq Masood "*Techno Economics Analysis to Reshape Global Clean and Green Energy"* 22nd International Conference on Renewable Energies and Power Quality (ICREPQ'24) Bilbao (Spain), 26th to 28th June 2024

[18]. Jamil Abdo & Tariq Masood *"New Technique to develop Intelligent, highly reliable & Efficient Unmanned Power Generation Modular"* 22nd International Conference on Renewable Energies and Power Quality (ICREPQ'24) Bilbao (Spain), 26th to 28th June 2024

[19]. Jamil Abdo & Tariq Masood "*Operational Reliability-Production Best Practice Pragmatic Case Studies & Improvement*" published in Proceedings of the 9th North American Conference on Industrial Engineering and Operations Management Washington D.C., USA, June 4-6, 2024.

[20]. Tariq Masood & Jamil Abdo "*Maintenance strategy production best practices – pragmatic case studies and operations improvement*" published in Proceedings of the 9th North American Conference on Industrial Engineering and Operations Management Washington D.C., USA, June 4-6, 2024

[21]. Tariq Masood R. K. Aggarwal and Nasser Al-Emadi "Enhanced Power Flow/Voltage Control in the GCC Grid by SSSC Robustness" published: ISBN: 978-3-659-40995-0. https://www.morebooks.de/shop-ui/shop/search?q=978-3-659-40995-0&page

[22]. Tariq Masood, DP Kothari "Centralized and Decentralized FACTS Controllers in Electric Power Grid" Subtitle: Innovative Robust Control Applied to Selected Power System published by New Age International. ISBN : 978-93-87788-31-2 http://www.newagepublishers.com/servlet/nagetbiblio?bno=002900

[23]. Tariq Masood, Muhammad Tajammal, Samer Kareem, Suhail Aftab Qureshi, Abdul Jabbar Khan, DP Kothari, Nair Jameel" Unified power Flow Controller Modeling and Analysis Technique on the GCC Power Grid Operations and Control" published IEEE Energy Con, 2018 June 7-9 Limassol Cyprus. https://ieeexplore.ieee.org/document/8398834/

[24]. Tariq Masood, Muhammad Tajammal, Samer Kareem, Suhail Aftab Qureshi, Murtaza Hashmi, Nasir Jameel "Unified power Flow Controller (UPFC) Modeling and Analysis Technique by using Matlab and EMTP" published (ICREQP,18 Salamanca Spain 21-23 March,2018). http://www.icrepq.com/icrepq18/250-18-masood.pdf

[25]. Tariq Masood, Muhammad Tajammal, Samer Kareem, Suhail Aftab Qureshi, Murtaza Hashmi Naser Jameel "STATCOM Controller Performance Enhancement and Optimization Technique" published (ICREQP,18 Salamanca Spain 21-23 March,18). http://www.icrepq.com/icrepq18/249-18-masood.pdf

[26]. Tariq Masood, D.P.Kothari "Centralized/Decentralized FACTS Controllers in Electric Grids" published by New Age International India, UK. https://www.amazon.in/Centralized-Decentralised-Facts-Controllers-Electric/dp/9387788318

[27]. Tariq Masood, Muhammad Tajammal, Samer Kareem, Suhail Aftab Qureshi, Murtaza Hashmi DP Kothari "Smart Grid Operational functions and Control Challenges by Implementing SSSC Tailored to Optimize performance in between Qatar and KSA on the GCC Electrical-power grid" published in the ASTESJ Journal Advances in Science, Technology and Engineering Systems Journal Vol. 2, No. 1, 30.09.2017. https://pdfs.semanticscholar.org/dfba/184b2f7697d4e1f56d3eae96e4a400d02cd7.pdf

[28]. Tariq Masood, Abdel Aty Edris, Suhail Aftab Qureshi, Muhammad Tajammal, Murtaza Hashmi DP Kothari, Samer Kareem "Smart Grid Operations and Control Challenge by Implementing STATCOM Tailored to Optimization Performance at the GCC Power Grid" published in the 13th IET International conference on AC and DC power Transmission Conference on 14-16 February, 2017. http://ieeexplore.ieee.org/document/7934988/

[29]. Tariq Masood, Abdel Aty Edris, Suahil Aftab Qureshi, Muhammad Tajammal, Murtaza Hashmi DP Kothari, Samer Kareem "SSSC tailored to optimization performance in Between United Arab Emirates and Oman on the GCC Power Grid" published in the 13th IET International conference on AC and DC power Transmission Conference on 14-16 February, 2017. http://ieeexplore.ieee.org/document/7934934/

[30]. Tariq Masood, R.K. Aggarwal, Nasser Al-Emadi , Suhail Aftab Qureshi, D.P. Kothari "Novel Control of a UPFC Connecting the Kingdom of Saudi Arabia and Kuwait in the GCC Interconnection", publication by International Journal of Automation and Power Engineering Volume 3 Issue 1, May 2014. https://www.academia.edu/34708818

[31]. Tariq Masood, R.K. Aggarwal Nasser Alemadi and D.P. Kothari "Novel Selection Approach of STATCOM Device Tailored and Optimized Engineering Configuration to Implement in Between Qatar and Bahrain': published by International Journal of Automation and Power Engineering Volume 3 Issue 1, March 2014. https://www.academia.edu/34708817

[32]. Tariq Masood, R.K. Aggarwal Nasser Alemadi and D.P. Kothari "Novel Control of a SSSC Connecting the United Arab Emirates and Oman on the GCC Power Grid Interconnection": published by International Journal of Automation and Power Engineering Volume 2 Issue 1, January 2013. https://www.academia.edu/27492136

[33]. Tariq Masood, Abdel Aty-Edris, Rashid A. Alammari R.K. Aggarwal, "Multiple FACTS devices integration through distributed control system and its application on the GCC interconnection" published in 7th IEEE GCC International conference for presentation on 18 November, 2013. http://ieeexplore.ieee.org/document/6705750/

[34]. Tariq Masood, R.K. Aggarwal, Nasser Al-Eamdi “Enhanced Power Flow/Voltage Control in the GCC Grid by SSSC Robustness” published by Lambert in 2013 ISBN: 978-3-659-40995-0.https://www.amazon.com/Enhanced-Power-Voltage-Control-Robustness/dp/3659409952

[35]. Tariq Masood, R.K. Aggarwal, S.A. Qureshi “Novel Control of a SSSC Connecting the Oman and United Arab Emirates in the GCC power Grid Interconnection” published in IJAPE International Journal of Automation and Power Engineering, Volume 2, issue 1 January, 2013. https://dn790008.ca.archive.org/0/items/IJAPE095/IJAPE095.pdf

[36]. Tariq Masood, R.K. Aggarwal, S.A. Qureshi, R.A.J Khan STATCOM and SVC Control Operations and Optimization during Network Fault Conditions: IEEE International Symposium on Industrial Electronics ISIE-2010 Bari Italy (04-07 July, 2010) http://ieeexplore.ieee.org/document/5636868/

[37]. Tariq Masood, R.K. Aggarwal, S.A. Qureshi, , R.A.J Khan “STATCOM Model against SVC Control Model Performance Analyses Technique by Matlab”: (ICREQP,10 Granada Spain 23-25 March,10). http://icrepq.com/icrepq'10/655-Masood.pdf

[38]. Tariq Masood, R.K. Aggarwal, S.A. Qureshi, , R.A.J Khan “STATCOM Model against SVC Control Model Performance Analyses Technique by Matlab”: published in RE & PQJ (Renewable Energy and Power Quality Journal), Vol.1, No.8, April 2010: https://doi.org/10.24084/repqj08.655 (ISBN: 978-84-613-7543-1)

[39]. Tariq Masood, R.K. Aggarwal, S.A. Qureshi, , R.A.J Khan “STATCOM Control Reconfiguration Technique for Steady State and Dynamic Performance Optimization during Network Fault Conditions”: (ICREQP,10 Granada Spain 23-25 March,10) http://www.icrepq.com/icrepq'10/656-Masood.pdf

[40]. Tariq Masood, R.K. Aggarwal, S.A. Qureshi, , R.A.J Khan “STATCOM Control Reconfiguration Technique for Steady State and Dynamic Performance Optimization during Network Fault Conditions”: publish in RE & PQJ (Renewable and Power Quality Journal), Vol.1, No.8, April 2010: https://doi.org/10.24084/repqj08.656 (ISBN: 978-84-613-7543-1)

[41]. Tariq Masood, Dr. S. A Qureshi, Dr. A.j Khan, Dr.Nasser Elamedi, Yacob Y.Almulla, S K Shah “FACTS Control Devices (STATCOM, SSSC and UPFC) Re-Configuration Techniques By Psim/Matlab” Papers published ICEE2007 on 11-12th April, 2007 at UET/RCET Lahore _ Pakistan. http://ieeexplore.ieee.org/document/4287295/